



European Technical Assessment

ETA 22/0003 of 19/11/2025

General Part

**Technical Assessment Body issuing the
ETA:**

TECNALIA RESEARCH & INNOVATION

Trade name of the construction product

GOTHERM

**Product family to which the
construction product belongs**

External Thermal Insulation Composite
System with rendering on expanded
polystyrene (EPS) for use as external
thermal insulation to the wall of buildings.

Manufacturer

Colorificio Gottardo S.r.l.
Strada Statale Valli 193 (S.S. Romea)
IT-30015 Chioggia (Ve)
Italy
www.colorificiogottardo.it

Manufacturing plant

Zona Industriale
IT-30015 Valli di Chioggia (Ve)
Italy

**This European Technical Assessment
contains**

19 pages including 1 Annex which form an
integral part of this assessment.

**This European Technical Assessment is
issued in accordance with regulation
(EU) No 305/2011, on the basis of**

EAD 040083-00-0404 External Thermal
Insulation Composite Systems (ETICS)
with Rendering

This version replaces

ETA 22/0003 of 25/03/2022

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body – Tecnalia Research & Innovation. Any partial reproduction has to be identified as such.





Table of contents

| | |
|---|----|
| 1. Technical description of the product..... | 3 |
| 2. Specification of the intended use(s) in accordance with the applicable European Assessment Document (hereinafter EAD) | 5 |
| 3. Performance of the product and references to the methods used for its assessment..... | 7 |
| 4. Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base..... | 16 |
| 5. Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD | 16 |
| ANNEX 1 CHARACTERISTICS OF THE COMPONENTS..... | 17 |





Specific parts

1. Technical description of the product

This product is an ETICS (External Thermal Insulation Composite System) with rendering – a kit comprising components which are factory-produced by the manufacturer or component suppliers. The ETICS manufacturer is ultimately responsible for all components of the ETICS specified in this ETA (European Technical Assessment).

The ETICS kit comprises a prefabricated insulation product of expanded polystyrene (EPS) to be bonded and mechanically fixed onto the wall. The methods of fixing and the relevant components are specified in Table 1. The insulation product is faced with a rendering system consisting of one or more layers (site applied), one of which contains reinforcement. The rendering is applied directly to the insulating panels, without any air gap or disconnecting layer.

The ETICS may include special fittings (e.g. base profiles, corner profiles) to treat details such as connections, apertures, corners, parapets, sills, etc. Assessment and performance of these components is not addressed on this ETA; however the ETICS manufacturer is responsible for adequate compatibility and performance within the ETICS when the components are delivered as a part of the kit.

The components of the kit are:

| | Components | Coverage (kg/m ²) | Thickness (mm) |
|---|---|-------------------------------|----------------|
| | ETICS purely bonded, bonded with supplementary mechanical fixing and mechanically fixed with supplementary adhesive. According to ETA holder's prescriptions the minimal bonded surface shall be at least 40%. National application documents shall be taken into account. | | |
| Insulation material with associated method of fixing | Insulation product: | | |
| | <ul style="list-style-type: none"> STANDARD EPS PANEL Factory prefabricated expanded polystyrene (EPS) board according to EN 13163 | -- | 40-160 |
| | <ul style="list-style-type: none"> EPS PANEL WITH GRAPHITE. Factory prefabricated expanded polystyrene (EPS) board according to EN 13163 | -- | 40-160 |
| | Adhesive: | | |
| | <ul style="list-style-type: none"> CEMENT PLAST PL (cement-based mortar in powder requiring addition of 24-25 % wt water) according to EN 998-1. Particle size 0.8 mm. | 2.6 – 3.9 (dry mix) | 2-3 (dry) |
| | Mechanical fixings | | |
| | <ul style="list-style-type: none"> Nailed-in plastic anchor ref. NF46040-7 Nailed-in plastic anchor ref. 275 TOP-FIS | | |
| Base coat | <ul style="list-style-type: none"> CEMENT PLAST PL (cement-based mortar in powder requiring addition of 24-25 % wt water) according to EN 998-1. Particle size 0.8 mm. | 3.2 – 4.5 (dry mix) | 2.5-3.5 (dry) |



| | Components | Coverage (kg/m ²) | Thickness (mm) |
|----------------------------|---|--|----------------|
| | Components | Coverage (kg/m ²) | Thickness (mm) |
| Glass fibre mesh | <ul style="list-style-type: none"> Alkali and slide resistant glass fibre mesh with mass per unit area of about 160 g/m² and mesh size of about 5.3 x 4.0 mm. | -- | 0.3 |
| Key coat | <ul style="list-style-type: none"> PRIMER F/01. Pigmented quartz primer | 0.2-0.25 | -- |
| Finishing coat | <ul style="list-style-type: none"> RIVESTIMENTO EVO External render based on acryl-siloxane binders according to EN 15284. Particle size 1.2 and 1.5 mm. | 2.5-3.1 | 1.2-1.5 |
| | <ul style="list-style-type: none"> RV SILOSSANICO External render based on siloxane binders according to EN 15284. Particle size 1.2 and 1.5 mm | 2.5-3.1 | 1.2-1.5 |
| Ancillary materials | Supplementary profiles: <ul style="list-style-type: none"> Polyvinyl chloride (PVC) or aluminium profiles for corners, expansion joints, junctions with doors and windows, balconies, etc. | Remain under the ETA holder responsibility | |

Table 1: Components GOTHERM

2. Specification of the intended use(s) in accordance with the applicable European Assessment Document (hereinafter EAD)

2.1. Intended use

This ETICS is intended for use as external insulation of building walls. The walls are made of masonry (bricks, block, stones...) or concrete (cast on site or as prefabricated panels). The characteristics of the walls shall be verified prior to use of the ETICS, especially regarding conditions for reaction to fire classification and for fixing of the ETICS either by bonding or mechanically. The ETICS is designed to give the wall, to which it is applied, satisfactory thermal insulation.

The ETICS is made of non load-bearing construction elements. It does not contribute directly to the stability of the wall on which it is installed, but it can contribute to its durability by providing enhanced protection from the effect of weathering.

The ETICS can be used on new or existing (retrofit) vertical walls. It can also be used on horizontal or inclined surfaces which are not exposed to precipitation.

The ETICS is not intended to ensure the airtightness of the building structure.

The choice of the method of fixing depends on the characteristics of the substrate, which could need preparation and shall be done in accordance with the national instructions.

The provisions made in this ETA are based on an assumed working life of 25 years as minimum, provided that the conditions laid down in the sections below (manufacturing, transport, installation, use, maintenance, etc) are met. The indications given on the working life cannot be interpreted as a guarantee given by the manufacturer, but should only be regarded as a means for choosing the appropriate products in relation to the expected economically reasonable working life of the works.

2.2. Manufacturing

The ETA is issued for the ETICS, on the basis of agreed data/information, deposited at Tecnalia Research & Innovation, which identifies the ETICS that has been assessed and judged. Changes to the ETICS or the components or their production process, which could result in this deposited data/information being incorrect, shall be notified to Tecnalia Research & Innovation before the changes are introduced. Tecnalia Research & Innovation will decide whether or not such changes affect the ETA and consequently the validity of the CE marking on the basis of the ETA and, if so, whether further assessment or alterations to the ETA shall be necessary.

2.3. Design and installation

The ETICS is installed on site. The installation instructions, including special installation techniques and provisions for the qualification of the personnel, are given in the manufacturer's technical documentation. It is responsibility of the manufacturer to guarantee

that the information about design and installation are easily accessible to the concerned people.

2.4. Packaging, transport and storage

The information on packaging, transport and storage is given in the manufacturer's technical documentation. It is responsibility of the manufacturer to ensure that this information is easily accessible for the concerned people.

2.5. Use, maintenance and repair

The finishing coat shall normally be maintained in order to fully preserve the ETICS's performance.

Maintenance includes at least:

- Visual inspections of the ETICS.
- The repairing of localised damaged areas due to accidents.
- The application of various products or paints, possibly after washing or ad hoc preparation.

Necessary repairs should be performed as soon as the need has been identified.

It is important to be able to carry out maintenance as far as possible using readily available products and equipment, without spoiling appearance. Only products which are compatible with the ETICS shall be used.

The information on use, maintenance and repair is given in the manufacturer's technical documentation. It is the responsibility of the manufacturer to ensure that this information is made know to the concerned people.



3. Performance of the product and references to the methods used for its assessment

The identification tests and the assessment for the intended use of this ETICS according to the Basic Work Requirements, were carried out in compliance with the EAD 040083-00-0404 External Thermal Insulation Composite Systems (ETICS) with Rendering (hereinafter referred as “EAD”).

Safety in case of fire (BWR 2)

3.1 Reaction to fire (EAD 040083-00-0404, Clause 2.2.1)

| Components | Max. organic content/Max. heat of combustion | Flame retardant content |
|---------------------------------------|--|-------------------------|
| Adhesive (CEMENT PLAST PL) | --/0.201 MJ/kg | No flame retardant |
| Insulation (EPS) | -- | No flame retardant |
| Fixings | -- | -- |
| Base Coat (CEMENT PLAST PL) | --/0.201 MJ/kg | No flame retardant |
| Glass Fibre Mesh 160 g/m ² | <20% / | No flame retardant |
| Key Coat (PRIMER F/01) | <18% / -- | No flame retardant |
| Finishing coat (RIVESTIMENTO EVO) | <9% / -- | No flame retardant |

Table 2: Organic content, heat of combustion and flame retardant content of GOTHERM components

The reaction to fire according to EN 13501-1 of GOTHERM ETICS with finishing coat RIVESTIMENTO EVO is class B-s1, d0.

The reaction to fire of thermal insulation material according to EN 13501-1 is class E.

The reaction to fire according to EN 13501-1 of GOTHERM ETICS with EPS thickness higher than 140 or finishing coat RV SILOSSANICO: performance not assessed.

Note: A European reference fire scenario has not been laid down for facades. In some Member States, the classification of ETICS according to EN 13501-1 might not be sufficient for the use in facades. An additional assessment of ETICS according to national provisions (e.g. on the basis of a large-scale test) might be necessary to comply with Member State regulations, until the existing European classification system has been completed.

3.2 Façade fire performance (EAD 040083-00-0404, Clause 2.2.2)

Performance not assessed.

3.3 Propensity to undergo continuous smouldering (EAD 040083-00-0404, Clause 2.2.3)

Not relevant.





Hygiene, health and environment (BWR 3)

3.4 Content, emission and/or release of dangerous substances (EAD 040083-00-0404, Clause 2.2.4)

Performance not assessed.

3.5 Water absorption (EAD 040083-00-0404, Clause 2.2.5)

3.5.1 Water absorption of the base coat and the rendering system

| Base Coat | Rendering | Water absorption (kg/m ² .h) | |
|-----------------|---------------------------------|---|----------------|
| | | After 1 hour | After 24 hours |
| CEMENT PLAST PL | Without rendering | 0.0137 | 0.0154 |
| | With rendering RIVESTIMENTO EVO | 0.0326 | 0.0126 |
| | With rendering RV SILOSSANICO | 0.0147 | 0.0125 |

Table 3: Water absorption (capillarity test)

3.5.2 Water absorption of the thermal insulation product.

Water absorption of the thermal absorption product has been obtained from the DoP of the thermal insulation panels according to EN 13163. See Annex 1 for declared values.

3.6 Hygrothermal behaviour (EAD 040083-00-0404, Clause 2.2.6)

The hygrothermal performance of the ETICS was tested on the rig.

None of the following defects occurred on the assessed external renderings or the base coat during and after the hygrothermal cycles:

- Blistering or peeling of any finishing coat.
- Failure or cracking associated with joints between insulation product boards or profiles fitted with ETICS.
- Detachment of the render coat.
- Cracking allowing water penetration to the insulating layer (normally ≤ 0.2 mm).

Therefore, the ETICS is considered resistant to hygrothermal cycles.

3.7 Freeze-thaw behaviour (EAD 040083-00-0404, Clause 2.2.7)

Water absorption of the base coat and all the finishing coats is lower than 0.5 kg/m² after 1 hour and 24 hours. Based on these test results, the system can be considered freeze-thaw resistant and there is no need for further testing.



3.8 Impact resistance (EAD 040083-00-0404, Clause 2.2.8)

The impact resistance of the ETICS was tested on the rig.

| Rendering system | Maximum Impact diameter (mm)/damage | | Category of use |
|--|-------------------------------------|--|-----------------|
| | 3 J | 10 J | |
| Base coat CEMENT PLAST PL + glass fibre mesh 160 g/m ² + key coat Primer F/01 + finishing coat RIVESTIMENTO EVO | 12.03/no cracking | 38.70/cracks without reaching the thermal insulation product | II |
| Base coat CEMENT PLAST PL + glass fibre mesh 160 g/m ² + key coat Primer F/01 + finishing coat RV SILOSSANICO | 13.01/no cracking | 38.36/cracks without reaching the thermal insulation product | II |

Table 4: Impact resistance

3.9 Water vapour permeability (resistance to water vapour diffusion) (EAD 040083-00-0404, Clause 2.2.9)

3.9.1 Water vapour permeability of the rendering system

| Composition of the system | | Thickness (m) | Equivalent air thickness S _d (m) |
|---|--|---------------|---|
| Reinforced base coat+ finishing coat | Base coat CEMENT PLAST PL + glass fibre mesh 160 g/m ² + key coat Primer F/01 + finishing coat RIVESTIMENTO EVO | 0.0045 | 0.7 |
| | Base coat CEMENT PLAST PL + glass fibre mesh 160 g/m ² + key coat Primer F/01 + finishing coat RV SILOSSANICO | 0.0045 | 0.6 |

Table 5: Water vapour permeability of the rendering system

3.9.2 Water vapour permeability of thermal insulation product

Water vapour permeability of the thermal insulation product has been obtained from the DoP of the thermal insulation panels according to EN 13163. See Annex 1 for declared values.

Safety and accessibility in use (BWR 4)

3.10 Bond strength

3.10.1 Bond strength between base coat and thermal insulation product (EAD 040083-00-0404, Clause 2.2.11.1)

| Composition | Initial State | | After hygrothermal cycles | | After freeze/thaw cycles | |
|--|---------------|------------|---------------------------|------------|--|------------|
| | Minimum value | Mean value | Minimum value | Mean value | Minimum value | Mean value |
| EPS panel + Base coat CEMENT PLAST PL + glass fibre mesh 160 g/m ² | 155 kPa | 169 kPa | 80 kPa | 106 kPa | Test not performed (system is considered freeze thaw resistant) | |

Table 6: bond strength between base coat and insulation product

Rupture type: cohesive break in the insulation material.

3.10.2 Bond Strength between adhesive and substrate (EAD 040083-00-0404, Clause 2.2.11.2)

| Composition | Initial State | | Immersion in water for 2 days and 2h drying | | Immersion in water for 2 days and 7 days drying | |
|--|---------------|------------|---|------------|---|------------|
| | Minimum value | Mean value | Minimum value | Mean value | Minimum value | Mean value |
| Concrete slab + adhesive CEMENT PLAST PL (3 mm thickness) | 802 kPa | 846 kPa | 966 kPa | 978 kPa | 2370 kPa | 2451 kPa |

Table 7: Bond strength between adhesive and substrate

Rupture type: cohesive break in the adhesive.

3.10.3 Bond Strength between adhesive and insulation product (EAD 040083-00-0404, Clause 2.2.11.3)

| Composition | Initial State | | Immersion in water for 2 days and 2h drying | | Immersion in water for 2 days and 7 days drying | |
|---|---------------|------------|---|------------|---|------------|
| | Minimum value | Mean value | Minimum value | Mean value | Minimum value | Mean value |
| EPS panel + adhesive CEMENT PLAST PL (3-5 mm thickness) | 115 kPa | 123 kPa | 62 kPa | 101 kPa | 107 kPa | 119 kPa |

Table 8: bond strength between adhesive and insulation product

Rupture type: cohesive rupture in the insulation material.



The minimal bonded surface S is calculated as follows:

$$S (\%) = [0.03 \times 100] / B$$

Where:

B= minimum mean failure resistance of the adhesive to the insulation product in dry conditions (MPa)

0.03 MPa correspond to the minimum requirements.

3.11 Fixing strength (transverse displacement strength) (EAD 040083-00-0404, Clause 2.2.12)

Not relevant. Minimum bonded surface 40% for ETICS mechanically fixed with supplementary adhesive.

3.12 Wind load resistance of ETICS (EAD 040083-00-0404, Clause 2.2.13)

3.12.1 Pull-through test (EAD 040083-00-0404, Clause 2.2.13.1)

| Characteristics of components | | | | |
|-------------------------------|--|--|-------------------|------------------------------|
| Anchors | Trade name | Apply to all anchors listed in Table 1 | | |
| | Plate diameter | ≥ 50 mm | | |
| EPS panels | Thickness (mm) | ≥ 40 | | |
| | Tensile strength perpendicular to the face (kPa) | ≥ 150 | | |
| Pull-through test | | | | |
| Failure loads (N) | Anchors not placed at the panel joints | R_{panel} | In dry conditions | Minimum: 270 Average: 294 |
| | Anchors placed at the panel joints | R_{joint} | | Minimum: 305 Average: 318 |

Table 9: pull-through test of fixings

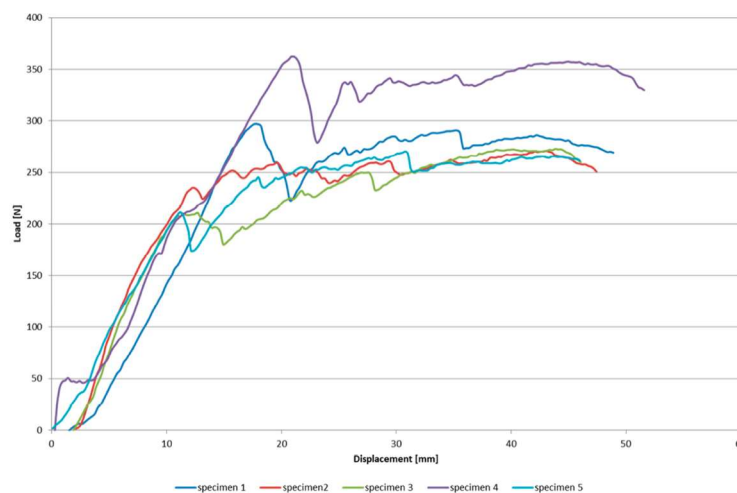


Figure 1: Load displacement graph of pull through tests at the body of the panel.



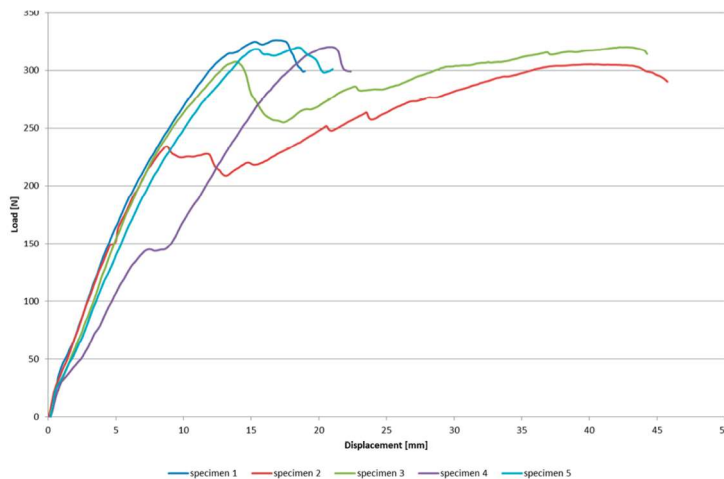


Figure 2: Load displacement graph of pull through tests at the joint of the panel

3.12.2 Static foam block test (EAD 040083-00-0404, Clause 2.2.13.2)

No performance assessed.

3.12.3 Dynamic wind uplift EAD 040083-00-0404, Clause 2.2.13.3)

Not relevant.

3.13 Tensile test perpendicular to the faces of thermal insulation product (EAD 040083-00-0404, Clause 2.2.14)

Tensile strength of thermal insulation product in dry conditions has been obtained from the DoP of the thermal insulation panels according to EN 13163. See Annex 1 for declared value.

Tensile strength of thermal insulation product in wet conditions is not applicable.

3.14 Shear strength and shear modulus of elasticity test of ETICS (EAD 040083-00-0404, Clause 2.2.15)

Shear strength ≥ 20 kPa. Shear modulus ≥ 1000 kPa.

3.15 Pull-through resistance of fixing from profiles (EAD 040083-00-0404, Clause 2.2.16)

Not relevant.

3.16 Render strip tensile test (EAD 040083-00-0404, Clause 2.2.17)

No performance assessed.

3.17 Shear strength and shear modulus of foam adhesive (EAD 040083-00-0404, Clause 2.2.18)

Not relevant.

3.18 Post expansion behaviour of foam adhesives (EAD 040083-00-0404, Clause 2.2.19)

Not relevant.

3.19 Bond strength after ageing (EAD 040083-00-0404, Clause 2.2.20)

Bond strength after ageing of finishing coats tested on the rig

| Rendering system | After hygrothermal cycles | | After freeze/thaw cycles | |
|--|---|-----------------------|---|------------|
| | Individual value/type of failure ⁽¹⁾ | Mean value | Minimum value | Mean value |
| Base coat CEMENT PLAST PL + glass fibre mesh 160 g/m ² + key coat Primer F/01 + finishing coat RIVESTIMENTO EVO | 140 kN/m ² / CS | 132 kN/m ² | Test not performed (system is considered freeze thaw resistant) | |
| | 140 kN/m ² / CS | | | |
| | 110 kN/m ² / CA | | | |
| | 140 kN/m ² / CS | | | |
| Base coat CEMENT PLAST PL + glass fibre mesh 160 g/m ² + key coat Primer F/01 + finishing coat RV SILOSSANICO | 120 kN/m ² / CS | 130 kN/m ² | Test not performed (system is considered freeze thaw resistant) | |
| | 130 kN/m ² / CS | | | |
| | 120 kN/m ² / CS | | | |
| | 150 kN/m ² / CS | | | |
| | 130 kN/m ² / CS | | | |

Table 10: Bond strength after ageing of finishing coats tested on the rig

⁽¹⁾ CS: cohesive failure in insulation material; CA: cohesive failure in base coat/adhesive.

3.20 Mechanical and physical characteristics of the mesh (EAD 040083-00-0404, Clause 2.2.21)

| | | Tensile strength in as delivered state (N/mm) | Residual tensile strength after ageing (N/mm) | Relative residual strength after ageing, of the strength in the as delivered state (%) | Elongation in as-delivered state (%) | Elongation after ageing (%) |
|---------------------------------------|------|---|---|--|--------------------------------------|-----------------------------|
| Glass fibre mesh 160 g/m ² | Warp | 44.3 | 36.5 | 82.4 | 3.7 | 3.1 |
| | Weft | 55.5 | 46.1 | 83.0 | 4.4 | 3.5 |

Table 11: Mechanical and physical characteristics of the mesh



Protection against noise (BWR 5)

3.21 Airborne sound insulation of ETICS (EAD 040083-00-0404, Clause 2.2.22)

No performance assessed.

Energy economy and heat retention (BWR 6)

3.22 Thermal resistance and thermal transmittance of ETICS (EAD 040083-00-0404, Clause 2.2.23)

The additional thermal resistance provided by the ETICS (R_{etics}) to the substrate wall is calculated from the thermal resistance of the insulation product ($R_{\text{insulation}}$), determined as described in the appropriate harmonized standard (EN 13163 for EPS insulation), and the tabulated R_{render} value of the render system (R_{render} is about 0.02 m²K/W).

$$R_{\text{etics}} = R_{\text{insulation}} + R_{\text{render}} \text{ [(m}^2\text{K)/W]}$$

The thermal bridges caused by mechanical fixing devices influence the thermal transmittance of the entire wall and shall be taken into account using the following calculation:

$$U_c = U + \Delta U \text{ [W/(m}^2\text{K)]}$$

With:

U_c = corrected thermal transmittance of the entire wall, including thermal bridges.

U = thermal transmittance of the entire wall, including ETICS, without thermal bridges.

$$U = \frac{1}{R_{\text{etics}} + R_{\text{substrate}} + R_{\text{se}} + R_{\text{si}}}$$

R_{etics} = thermal resistance of the ETICS [(m²K)/W]

$R_{\text{substrate}}$ = thermal resistance of the substrate wall [(m²K)/W]

R_{se} = external surface thermal resistance [(m²K)/W]

R_{si} = internal surface thermal resistance [(m²K)/W]

ΔU = correction term of the thermal transmittance for mechanical fixing devices.

$$\Delta U = X_p * n \text{ (for anchors)} + \sum \psi_i * \ell_i \text{ (for profiles)}$$

X_p = point thermal transmittance value of the anchor [W/K]. See Technical Report no 25. If not specified in the anchors ETA, the following values apply:

= 0.002 W/K for anchors with a plastic screw/nail, stainless steel screw/nail with the head covered by plastic material, and for anchors with an air gap at the head of the screw/nail.



= 0.004 W/K for anchors with a galvanized steel screw/nail with the head covered by a plastic material.

= 0.008 W/K for all other anchors (worst case).

n = number of anchors per m^2

ψ_i = linear thermal transmittance value of the profile [W/(mK)]

l_i = length of the profile per m^2

Thermal resistance of ETICS is $\geq 1.0 (m^2.K)/W$

The value of thermal resistance of each insulation product shall be given in the manufacturer's documentation along with the possible range of thicknesses. In addition, the point thermal conductivity of anchors shall be given when anchors are used in the ETICS.

The range value of thermal resistance of thermal insulation product is from 1.30 $(m^2.K)/W$ to 5.30 $(m^2.K)/W$ for the EPS panel with graphite and from 1.10 $(m^2.K)/W$ to 4.55 $(m^2.K)/W$ for the standard EPS panel (Values obtained from the DoP issued for thermal insulation).



4. Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base

According to the European Commission Decision 1997/556/EC, amended by the European Commission Decision 2001/596/EC, system AVCP 2+ applies.

In addition, for uses subject to regulations on reaction to fire and according to the European Commission Decision 1997/556/EC, amended by the European Commission Decision 2001/596/EC, system AVCP 2+ applies.


The AVCP systems are described in Annex V of Regulation (EU) N° 305/2011, as amended by Delegated Regulation (EU) N° 568/2014.

5. Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the Assessment and Verification of Constancy of Performance (AVCP) system are laid down in the control plan deposited at Tecnalia Research & Innovation.

The Control Plan is a confidential part of the ETA and is only handed over to the notified body involved in the assessment and verification of constancy of performance.

Issued in Azpeitia, on 19/11/2025



Miguel Mateos

Innovation and Conformity Assessment Point

Tecnalia Research & Innovation



ANNEX 1 CHARACTERISTICS OF THE COMPONENTS

Detailed information on the chemical composition and other identifying characteristics of the components has been deposited at Tecnalia Research & Innovation. Further information can be observed from the product data sheets, which are part of the Technical Documentation for this ETA.

Insulation product

STANDARD EPS PANEL Factory-made uncoated panels made of expanded polystyrene, according to EN 13163 “Thermal insulation products for buildings. Factory made products of expanded polystyrene (EPS)”

| Description and characteristics | Standard | Value | |
|---|------------|--|----|
| Density | | 18.0 ± 1 kg/m ³ | |
| Thickness | | 40-160 mm | |
| Reaction to fire | EN 13501-1 | Euroclass E | |
| Thermal conductivity (W/mK) | EN 12667 | ≤ 0.035 | |
| Thermal resistance (m ² K/W) | ---- | Defined in the declaration according to EN 13163 | |
| Thickness (mm) | EN 823 | T1 | ±1 |
| Length (mm) | EN 822 | L2 | ±2 |
| Width (mm) | EN 822 | W2 | ±2 |
| Squareness (mm/m) | EN 824 | S2 | ≤2 |
| Flatness (mm) | EN 825 | P3 | ≤3 |
| Dimensional stability under specified temperature | EN 1603 | DS (N) 2 | |
| Dimensional stability under specified temperature and humidity | EN 1604 | DS (70,-) 1 | |
| Water absorption (partial immersion) | EN 12087 | WL(P)0.5 | |
| Water vapour permeability – diffusion factor | EN 12086 | 30-70 | |
| Tensile strength perpendicular to the faces in dry conditions (kPa) | EN 1607 | TR150 | |
| Bending behaviour (for mechanical fixing panels) | EN 12089 | BS150 | |
| Compression behaviour | EN 826 | CS(10)100 | |
| Shear Strength (kPa) | EN 12090 | ≥ 20 | |
| Shear Modulus of elasticity (kPa) | EN 12090 | ≥ 1000 | |

EPS PANEL WITH GRAPHITE Factory-made uncoated panels made of expanded polystyrene EPS with graphite, according to EN 13163 “Thermal insulation products for buildings. Factory made products of expanded polystyrene (EPS)”

| Description and characteristics | Standard | Value | |
|---|------------|--|----|
| Density | | 20 ± 2 kg/m ³ | |
| Thickness | | 40-160 mm | |
| Reaction to fire | EN 13501-1 | Euroclass E | |
| Thermal conductivity (W/mK) | EN 12667 | ≤ 0.030 | |
| Thermal resistance (m ² K/W) | ---- | Defined in the declaration according to EN 13163 | |
| Thickness (mm) | EN 823 | T1 | ±1 |
| Length (mm) | EN 822 | L2 | ±2 |
| Width (mm) | EN 822 | W2 | ±2 |
| Squareness (mm) | EN 824 | S2 | ≤2 |
| Flatness (mm) | EN 825 | P3 | ≤3 |
| Dimensional stability under specified temperature | EN 1603 | DS (N) 2 | |
| Dimensional stability under specified temperature and humidity | EN 1604 | DS (70,-) 1 | |
| Water absorption (partial immersion) | EN 12087 | WL (P) 0.5 | |
| Water vapour permeability – diffusion factor | EN 12086 | 30-70 | |
| Tensile strength perpendicular to the faces in dry conditions (kPa) | EN 1607 | TR150 | |
| Bending behaviour (for mechanical fixing panels) | EN 12089 | BS150 | |
| Compression behaviour | EN 826 | CS(10)100 | |
| Shear Strength (kPa) | EN 12090 | ≥ 20 | |
| Shear Modulus of elasticity (kPa) | EN 12090 | ≥ 1000 | |



Mesh

Mesh 160 g/m² Alkali and slide resistant glass fibre mesh with mass per unit area of about 160 g/m² and mesh size of about 5.3 x 4.0 mm.

| Characteristics | Reference | Value |
|--|--------------------|------------------|
| Mass per unit area (g/m ²) | EAD 040016-00-0404 | 160 (± 5%) |
| Mesh size (mm) | | 5.3 x 4.0 (± 5%) |
| Thickness (mm) | | 0.30 (± 0.1) |
| Ash content (%) | | 82.5 (± 0.3%) |
| Organic content (%) | | 17.5(± 0.3%) |
| Heat of combustion (PCS-value) (MJ/kg) | | Not assessed |

Plastic fixings

NF46040-7 Nailed-in plastic anchor for fixing of external thermal insulation composite systems with rendering in concrete and masonry (ETA 12/0297).

| GENERAL CHARACTERISTICS | |
|---|-------------|
| Plate diameter (mm) | 60 |
| Characteristics resistance in the substrate | ETA 12/0297 |

275 TOP-FIS Nailed-in plastic anchor for fixing of external thermal insulation composite systems with rendering in concrete and masonry (ETA 11/0315).

| GENERAL CHARACTERISTICS | |
|---|-------------|
| Plate diameter (mm) | 50 |
| Characteristics resistance in the substrate | ETA 11/0315 |

